
## GENERAL NOTES :

- 1. ALL ELECTRICAL INSTALLATION WORKS HEREIN BE DONE IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS. THE APPLICABLE PROVISIONS OF THE LATEST EDITION OF THE PILIPPINE ELECTRICAL CODE. THE RULES AND REGULATIONS OF THE LOCAL ENFORCING AUTHORITY. THE ELECTRICAL WORKS SHALL BE UNDER THE IMMEDIATE SUPERVISION OF A DULY LICENSED MECHANICAL ENGINEER.
- 2. THE ELECTRIC SERVICE SHALL BE SINGLE PHASE, 2-WIRE, 230 VOLTS WITH GROUND & NEUTRAL WIRE.
- THE ELECTRICAL PIPINGS INSTALLATION SHALL BE DONE IN COPPER PIPES, COMPLETE WITH FITTINGS, FULLY INSULATED SHALL BE USED WHEN REQUIRED. MINIMUM SIZE SHALL BE % INCHES INSIDE DIAMETER OR MECHANICAL TRADE SIZE.
- 4. ALL WIRES SHALL BE COPPER AND THERMOPLASTIC INSULATED TYPE THHN' OR THM' UNLESS OTHERWISE INDICATED. THE MINIMUM SIZE FOR POWER, AND GOLINDING SHALL BE 35mm<sup>2</sup>. THE CONTROL WIRES SHALL BE AS INDICATED OR AS SPECIFIED ELSEWHERE ON THE PLANS. ALL GOLIND WIRES SHALL BE GREEN.
- ALL EQUIPMENT, SWITCHES, PANEL BOARDS, OUTLETS, DIVICES AND ALL NON-CURRENT CARRYING METAL PARTS SHALL BE PROPERLY GROUNDED IN ACCORDANCE WITH THE PHILIPPINE MECHANICAL CODE.
- ALL FEEDERS SHALL BE INSTALLED AS INDICATED ON THE PLANS. BRANCH CIRCUIT HOMERUN WIRES SHALL BE INSTALLED IN INDIVIDUAL HOMERUN CONDUITS.
- 6. ANY DISCREPANCY IN LOCATION AND RATINGS EQUIPMENT, LENGTH OF WIRE, SHALL BE VERIFIED WITH THE OWNER OR ANY OF HIS REPRESENTATIVES.
- ALL MATERIALS TO BE USED AND THE EQUIPMENT TO BE INSTALLED SHALL BE BRAND NEW AND MUST BE OF THE APPROVED TYPE FOR THE PARTICULAR LOCATION AND PURPOSE INTERDED. BRAND NAME SHALL BE AS PRESCRIBED BY THE OWNER OR AS REQUIRED BY BUILDING / ADMIN.
- 8. ALL MOUNTING HEIGHT SHALL BE SUBJECT TO ENGINEERS APPROVAL PRIOR TO INSTALLATION.
- THE CONTRACTOR SHOULD ALWAYS VERIFY THE ACTUAL LAYOUT FOR , EQUIPMENTS, DEVICES, WIREWAY, PANEL BOARDS, AVR, TRANFORMER AND OTHER PARTICULARS THAT MIGHT BE CHANGED FROM TIME TO TIME FOR THE REASON OF THE UNFORSEEN PPROBLEMS.

CKT No.	LOAD DESCRIPTION	c.c		WATTS/ OUTLET	VOLTS	Hz	WATTS	AB	BC	CA	3PH	СВ	WIRE & CONDUIT
1	LIGHTING LOAD 1 (VESTIBULE 1)		12	50	230	60	600	2.61				20 A	3.5mm² THHN in 25mm Ø condu
2	LIGHTING LOAD 2 (EXHIBIT AREA 1)		37	50	230	60	1850	8.04				20 A	3.5mm <sup>2</sup> THHN in 25mm Ø condu
3	LIGHTING LOAD 3 (EXHIBIT AREA 2)		37	50	230	60	1850	8.04	· · · · ·	<u> </u>		20 A	3.5mm <sup>2</sup> THHN in 25mm Ø condu
4	LIGHTING LOAD 4 (VESTIBULE 2)		12	50	230	60	600	2.61				20 A	3.5mm² THHN in 25mm Ø condu
5	LIGHTING LOAD 5 (STORE)	Г	12	50	230	60	600	2.61				20 A	3.5mm <sup>2</sup> THHN in 25mm Ø condu
6	CONVENIENCE OUTLET		3	360	230	60	1080			4.70		40A	5.5mm² THHN in 25mm Ø condu
7	CONVENIENCE OUTLET		3	360	230	60	1080	4.70				40A	5.5mm <sup>2</sup> THHN in 25mm Ø condu
8	CONVENIENCE OUTLET	Г	3	360	230	60	1080		4.70			40A	5.5mm² THHN in 25mm Ø condi
9	HOLOGRAM OUTLET 1		7	1000	230	60	7000	1		30.43		60A	5.5mm² THHN in 25mm Ø condi
10	HOLOGRAM OUTLET 2		6	1000	230	60	6000		26.09	_		60A	5.5mm² THHN in 25mm Ø condi
11	SPARE 1		1	500	230	60	500	2.17	· · · · ·	<u> </u>		30 A	3.5mm <sup>2</sup> THHN in 25mm Ø condi
12	SPARE 2		1	500	230	60	500	1	2.17			30A	3.5mm <sup>2</sup> THHN in 25mm Ø cond
13	SPARE 3		1	500	230	60	500	2.17				30A	3.5mm <sup>2</sup> THHN in 25mm Ø cond
14	SPARE 4 (Motor loads)		1	2500	230	60	2500			· · · ·	85.00	100A	30.0mm <sup>2</sup> THHN in 25mm Ø cone
								32.96	32.96	35.13	85.00	125 A	3-50.0 mm2 THHN + 1- 8.0 mm2 1



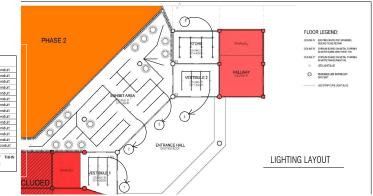

CONTRACTOR:	PROFESSIONAL ELECTRICAL ENGINEER:	PRC	PROJECT:	OWNER:	PREPARED BY: RLA	SHEET CONTENTS:	SHEET NO:.
		PTR	PROPOSED INTERIOR RENOVATION OF	NATIONAL ACADEMY OF SCIENCE	RECOM. APPROVAL:	_	5.1
		DATE	THE NEW SAEINEATH MOSEOW		REVISION:		E-1
		PLACE	( PHASE 1)		REV.# / DATE	AS SHOWN	SCALE:
PHOM THE ABOVE MEMTIONED C O M P A N Y 864 JP. Kind Street, Barongay Poblacian, Makati City, Metro Munika 1210		TN	LOCATION: DOST COMPOUND, BICUTAN, TAGUIG CITY		CHECKED BY:		AS SHOWN